


# OSU 3 Year Cu-Bor vs Others

Southern Yellow Pine Poles, Georgia Power

## Copper

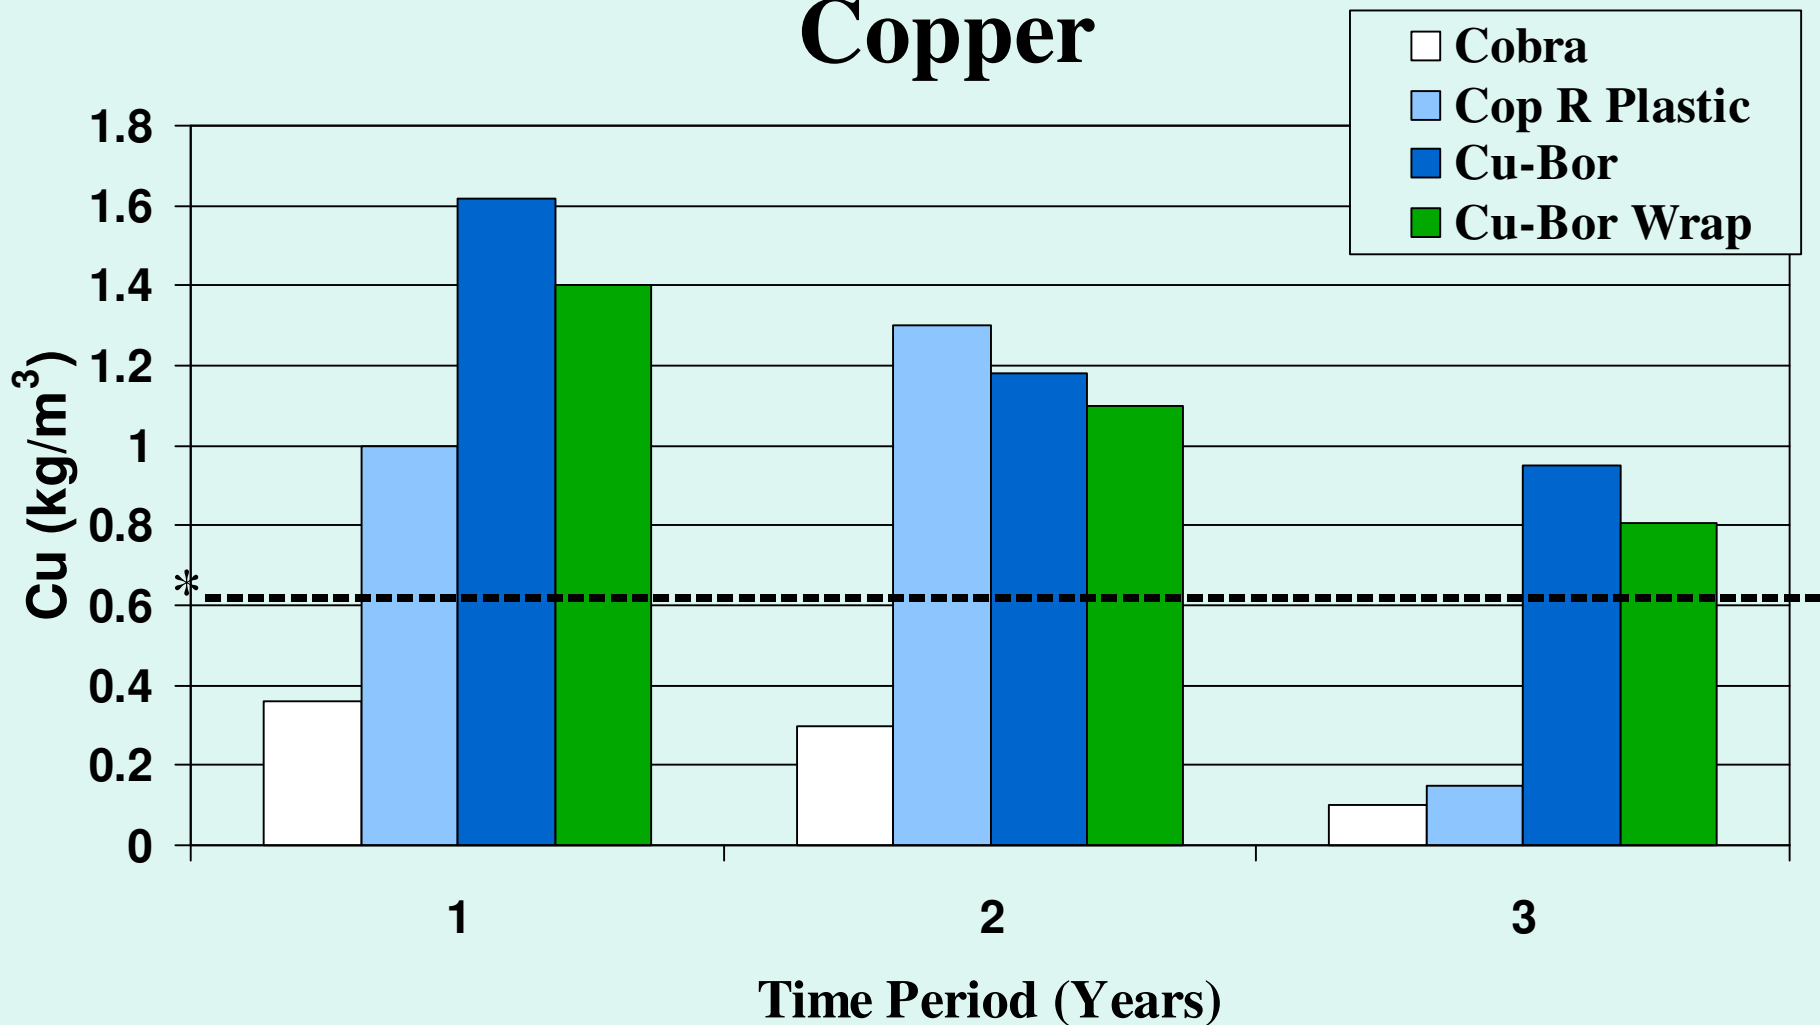


\* Threshold = .6 Cu (kg/m³)

Sample from G.L., Outer Segment

# OSU 3 Year Cu-Bor vs Others

Southern Yellow Pine Poles, Georgia Power

## Borates

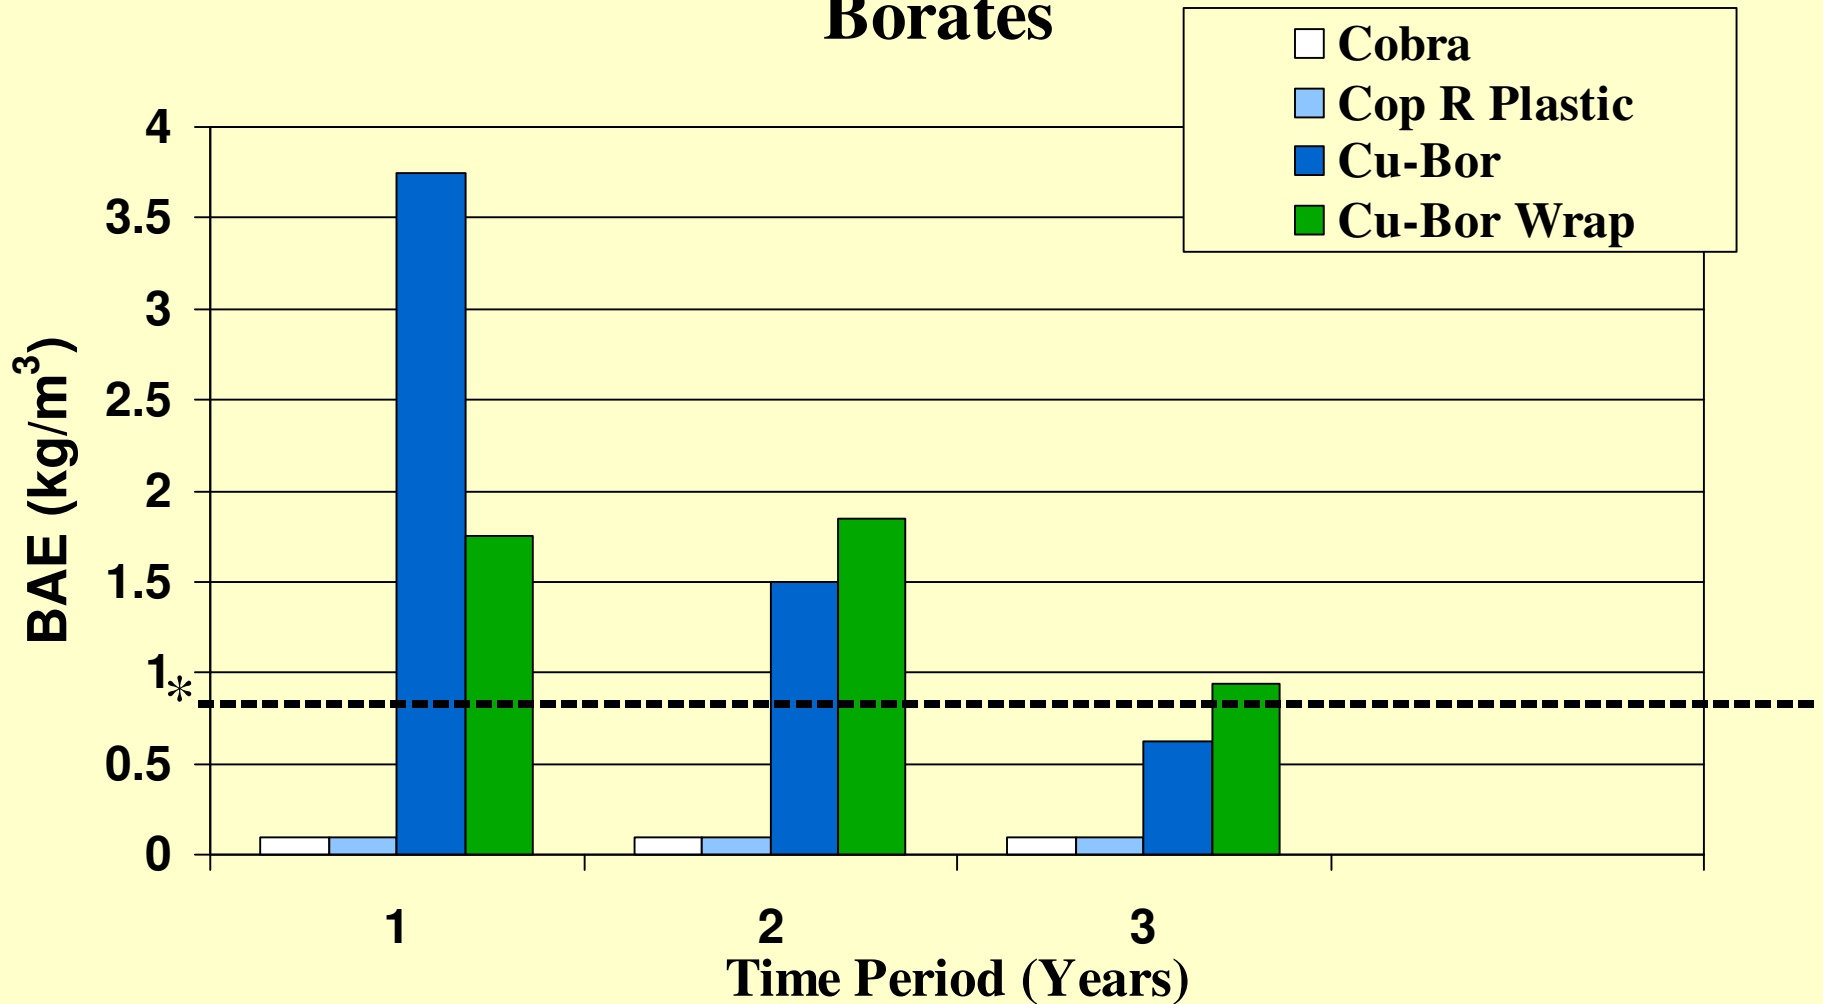

\* Threshold = .5 BAE (kg/m<sup>3</sup>)

Sample from G.L., Outer Segment